




Power factor in electrical systems is often referred to but frequently not fully understood. This information sheet discusses power factor as regards its explanation and how it relates to generator systems.

1.0 DEFINING POWER FACTOR:


In a purely resistive AC circuit, the voltage and current waveforms are in step (or in phase), changing polarity at the same instant in each cycle (*see diagram one*). Where reactive loads are present, such as with capacitors or inductors (like electric motors, strip heaters, cooking stoves, lamp ballasts, etc.), the energy stored in the loads results in a time difference between the current and voltage waveforms, as the stored energy is not available to do work at the load it is termed apparent power. This is known as a lagging power factor (which is less than 1.0)

Diagram One

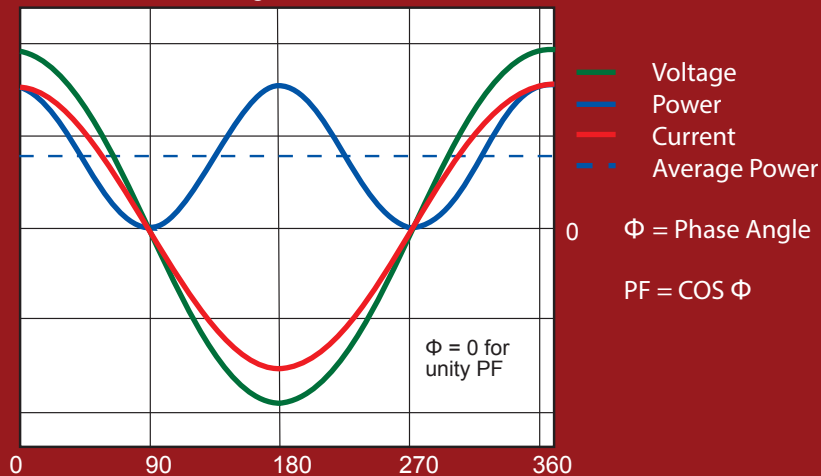


Purely resistive load connected with volts and amps in step for an unity (1) power factor when all the source energy is transferred and available to the load. Good power factors are normally greater than 0.9 to 0.95.

Diagram Two

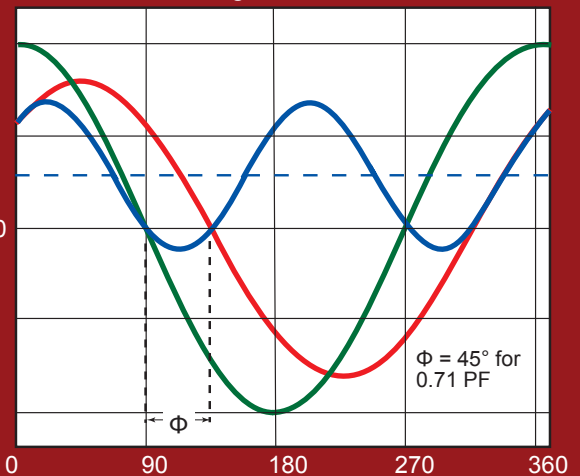

Inductive load connected with current waveform lagging volts. Below unity PF only a percentage of the power is available at the load. i.e 0.8 PF has real power 80% of apparent power. Reactive loads have a percentage of power returned to the source.

Diagram Three

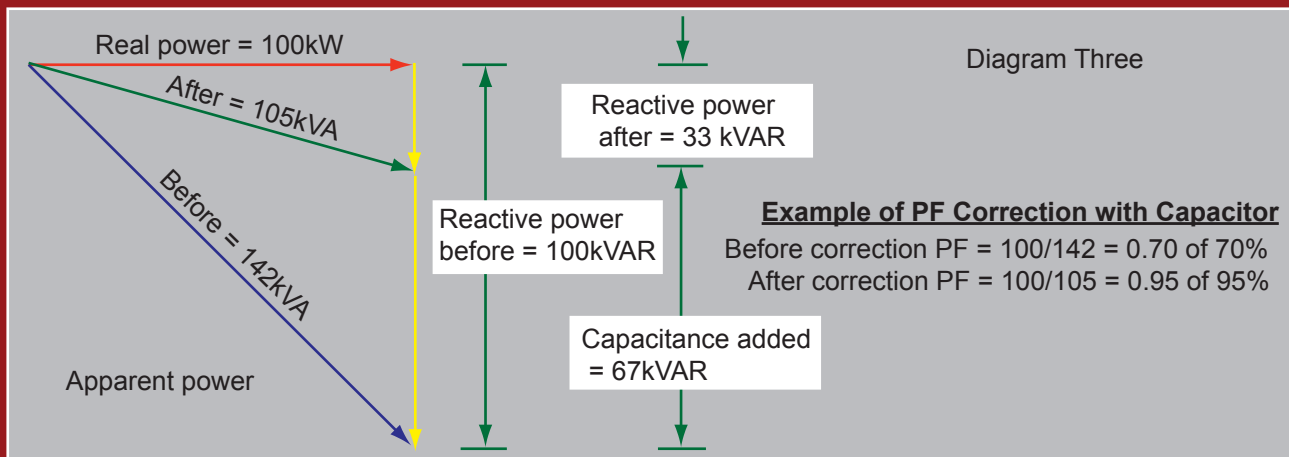

The installation information provided in this information sheet is informational in nature only, and should not be considered the advice of a properly licensed and qualified electrician or used in place of a detailed review of the applicable National Electric Codes and local codes. Specific questions about how this information may affect any particular situation should be addressed to a licensed and qualified electrician.

1.0 DEFINING POWER FACTOR (CONTINUED):

In a purely resistive AC circuit, the voltage and current waveforms are in step (or in phase), changing polarity at the same instant in each cycle (*see diagram one*). Where reactive loads are present, such as with capacitors or inductors (like electric motors, strip heaters, cooking stoves, lamp ballasts, etc.), the energy stored in the loads results in a time difference between the current and voltage waveforms, as the stored energy is not available to do work at the load it is termed apparent power. This is known as a lagging power factor (which is less than 1.0)

Power factor, as shown in vector diagram (*see diagram two*) is the ratio of true power (shown as watts (W) amps x volts) to the apparent power (shown as VA amps x volts) flowing to the load in an alternating current (AC) system. Watts and VA are more commonly quoted in thousands as kW and kVA. kW and kVA in an AC system are only the same when power factor has a value of one (unity). More frequently equipment is designed to have a power factor equal to 0.8.

2.0 DIFFERENCE BETWEEN TRUE POWER - KW AND APPARENT POWER - KVA AND REACTIVE POWER:

In an AC system, such as inductive motors, transformers and solenoids, internal electrical energy is required for magnetization of items such as a motor's field coils. This internal power stored and discharged within an inductive piece of equipment is referred to as reactive power and measured as volts x amps reactive (VAR). Without internal magnetization the AC equipment would not function.

The more reactive power required for magnetization of the internal inductive load, the greater the unusable power and increase in apparent power (kVA) requirements within the electrical system. As shown in diagram one, the greater the value of apparent power (kVA) the lower the power factor and by ratio the lower the real power available, given in kW.

In layman's terms, power factor has as more to do with the internal inductive loads of AC electrical equipment and the resultant true power kW available. A system designer endeavors to select equipment and design a system that reduces the drop in power factor. A system with a low power factor increases the energy lost in the system and requires a much greater input than can be used effectively to power equipment. Generator sets are normally rated for power factors between 0.8 and unity.

In summary, apparent power kVA is the power required to serve the equipment's internal reactive load power requirements and true power kW is the power available after reactive power has been satisfied.

3.0 ADVERSE EFFECTS AND WHY TO AVOID LOW POWER FACTOR:

A system load with a low power factor will draw more current than a system with a higher power factor A system designer considers the following:

- A Low power factor draws a higher internal current and the excessive heat generated will damage and/or shorten equipment life
- Increased reactive loads can reduce output voltage and damage equipment sensitive to reduced voltage
- Low power factor requires equipment to be constructed heavier to absorb internal energy requirements
- Low power factor will result in a more expensive system with equipment able to absorb internal loads and larger load requirements
- A system designer looks to increase power factor to lower system costs, increase reliability and increase the system's life cycle
- Utilities will charge a higher cost to industrial and commercial clients having a low power factor.

4.0 METHODS TO INCREASE POWER FACTOR AND LOAD TYPES:

Electrical system designers endeavor to increase the power factor to as near as 1.0 as possible by incorporating power factor 'corrector' devices within the system. Power factor correction methods adopted depend on whether the load is termed linear or non-linear.

Linear Load - These are loads such as induction motors and transformers that can be corrected with the addition of a passive network of capacitors or inductors. Capacitors store electrical power that can be used to excite the internal magnetic fields and reduce the required apparent power kVA. (*see diagram three*)

Non- Linear Load - These loads include equipment that has components such as rectifiers, some form of arc discharge such as fluorescent lamps, electric welders, arc furnaces, etc. This type of load will distort the current drawn into a system. The current in non-linear loads is interrupted by switching devices within the equipment. Switching causes the current to contain frequency components that have multiple power factor frequencies.

For non-linear loads, captive or passive power factor correction can be incorporated to counter the distortion and elevate the power factor.

Power factor correction devices can be installed either at a central substation, spread throughout the distribution system, or built into the power-consuming equipment

Non Reactive Loads - These loads are purely resistive such as heater elements and incandescent lights and do not effect power factor.

To fulfill our commitment to be the leading supplier in the power generation industry, the Buckeye Power Sales team ensures they are always up-to-date with the current power industry standards as well as industry trends. As a service, our Information Sheets are circulated on a regular basis to existing and potential power customers to maintain their awareness of changes and developments in standards, codes and technology within the power industry.



CANAL WINCHESTER, OH
8155 Howe Industrial Parkway
Canal Winchester, OH 43110
(614) 751-4515
(866) 889-2628

CINCINNATI, OH
4992 Rialto Road
West Chester, OH 45069
(513) 755-2323
(800) 368-7422

CLEVELAND, OH
8465 Tower Drive
Twinsburg, OH 44087-0394
(330) 425-9165
(800) 966-2825

TOLEDO, OH
12400 Williams Road
Perrysburg, OH 43551
(855) 638-2728

CHICAGO, IL
1308 Marquette Drive
Romeoville, IL 60446
(630) 914-3000

INDIANAPOLIS, IN
1707 S. Franklin Road
Indianapolis, IN 46239
(317) 271-9661
(800) 632-0339

FORT WAYNE, IN
7525 Maplecrest Road #221
Fort Wayne, IN 46835
(855) 638-2721