




We note an emerging trend towards UL2085 for above-ground generator fuel tanks with secondary containment. Stringent EPA controls on Underground Storage Tanks (UST's), and larger penalties for ground contamination, have led to much greater usage of Above-Ground Storage Tanks (AST's). However, once above ground in addition to environmental factors we have to consider the safe use and storage of flammable fuel

1.0 INTRODUCTION:

The illustration shows a typical design for a "beside installation" vaulted fuel tank. Other forms of vaulted tanks to UL 2085 permit the generator set to be mounted above the tank. Above 500 gallons, many cities, specify these tanks and, in most cases, NFPA 37 requires extra precautions above 500 gallons.

Fire departments are demonstrating a keen preference for this type of tank, and we foresee this as the standard tank for the future.

Diagram of Fuel Tank to UL 2085

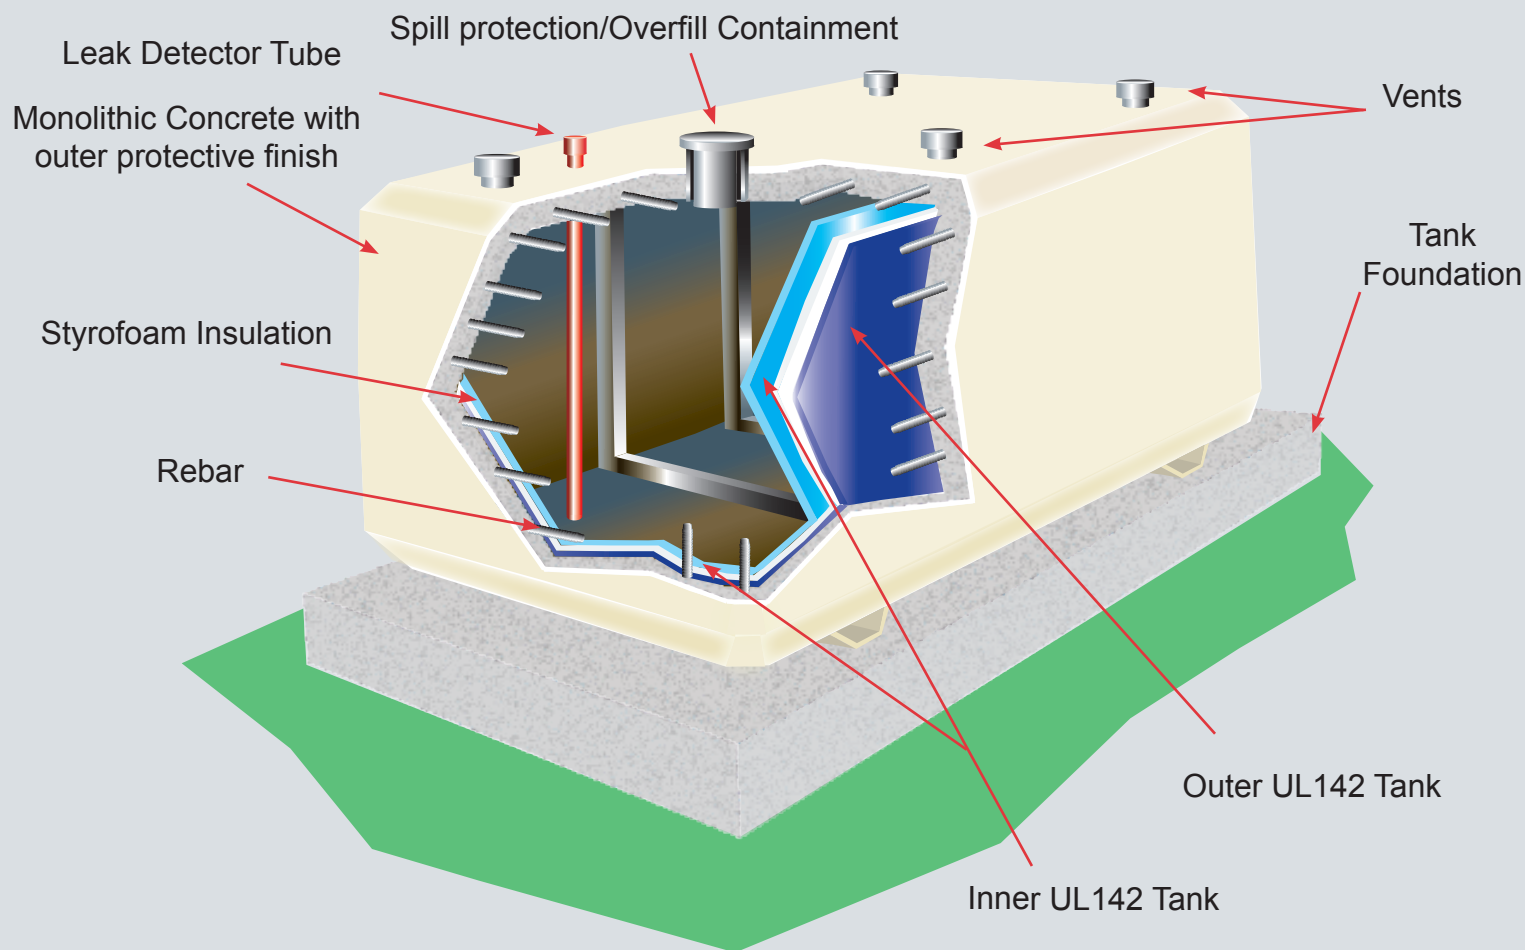

The installation information provided in this information sheet is informational in nature only, and should not be considered the advice of a properly licensed and qualified electrician or used in place of a detailed review of the applicable National Electric Codes and local codes. Specific questions about how this information may affect any particular situation should be addressed to a licensed and qualified electrician.

2.0 KEY SAFETY FACTORS AND CODES TO BE CONSIDERED IN FUEL TANK DESIGN ARE:

- Ability to Withstand Fire (UL 2085 Section 17)
- Vehicle Impact Resistance (UL 2085 Section 20)
- Projectile Resistance (UL 2085 Section 21)

In addition to UL standards, fuel tanks also have to meet all NFPA Fire Code requirements.

The information in this sheet gives details of the designs Fuel Tank manufacturers are using to meet the dictates of UL 2085, UL142, NFPA 30, 37, and 110, and address the safety factors listed above.

Manufacturers have taken the concept of the UL142 double-walled fuel tanks, and achieved compliance to UL 2085 by a combination of rigid design, stronger carbon steel materials, and insulation between outside and inside containment walls.

These additional features give the fuel tank the ability to:

1. **Withstand fire:** With 2-hour liquid pool and furnace fire tests, the primary internal tank sees on average a temperature rise of no more than 260° F.
2. **Resist Vehicle Impact:** Maintain fuel containment after an impact of 12,000 lbs force @ 10mph.
3. **Resist Projectiles:** One manufacturer quotes a test with 150-grain, 30-caliber bullet, muzzle velocity 2,700 feet per sec. from 100'.

3.0 USEFUL WEB-SITES FOR FURTHER INFORMATION:

- Underwriters Laboratory: <https://www.ul.com/>
- NFPA: <https://www.nfpa.org/>

The Buckeye Power Sales technical support team will be very happy to discuss specific needs with you, and provide you with further information and details of all available options to satisfy the requirements of UL 2085 and any other questions concerning your power needs.

Buckeye Power Sales have branches in Ohio, Illinois, and Indiana, with full sales and support capabilities with 24-hour local support.

To fulfill our commitment to be the leading supplier in the power generation industry, the Buckeye Power Sales team ensures they are always up-to-date with the current power industry standards as well as industry trends. As a service, our Information Sheets are circulated on a regular basis to existing and potential power customers to maintain their awareness of changes and developments in standards, codes and technology within the power industry.



CANAL WINCHESTER, OH
8155 Howe Industrial Parkway
Canal Winchester, OH 43110
(614) 751-4515
(866) 889-2628

CHICAGO, IL
1308 Marquette Drive
Romeoville, IL 60446
(630) 914-3000

CINCINNATI, OH
4992 Rialto Road
West Chester, OH 45069
(513) 755-2323
(800) 368-7422

INDIANAPOLIS, IN
1707 S. Franklin Road
Indianapolis, IN 46239
(317) 271-9661
(800) 632-0339

CLEVELAND, OH
8465 Tower Drive
Twinsburg, OH 44087-0394
(330) 425-9165
(800) 966-2825

FORT WAYNE, IN
7525 Maplecrest Road #221
Fort Wayne, IN 46835
(855) 638-2721

TOLEDO, OH
12400 Williams Road
Perrysburg, OH 43551
(855) 638-2728